



Test Report number: 9813203277/1

Inspection certificate number 9813203277 has been canceled, it took her place.

1. Order Information:

Customer's Name: CANADIAN SOLAR INC

Customer's address: 545 Speedvale Avenue, West Guelph, Ontario N1K 1E6, Canada

Date of order: 01.02.2018

The sample was taken by a representative of the customer

2. Test of:

Photovoltaic module

Model : CS6U-XXXP

Manufacturer : CANADIAN SOLAR

Country of manufacture : CHINA

Module type : Poly-crystalline

Num. of cells in module : 72

Overall dimensions : 1960 mm X 992 mm X 40 mm

3. Details of Sampling:

Date of Sampling : 23.02.2018

Sampling By : Customer

Number of Sampling : 1

4. Nature of Testing:

Compliance of the model with the requirements of the International Standards:

IEC 61730 - Photovoltaic (PV) module safety qualification

Part 1: clauses 3,4,5,6,7,8,9,10,11,12

Part 2: clauses 3,6,9,10,11

SI 61215 - Crystalline silicon terrestrial photovoltaic (PV) modules :

clause 10.17 (Hail test) Design qualification and type approval.

5. Conclusion:

The module complies with the requirements of the clauses to which they were tested.

Notes: This example is representative for sample modules: **CS6U-XXXP** (XXX = 315-350), IEC1500V, 3.2mm.

This document alone is not used to release goods from customs.

This report refers only to the sample tested and does not refer to other samples of the same product.

This document contains 7 pages, and may be used only in full.

Eng. Ido Cohen

עידו כהן
מנהל מעבדת הבדיקות
מכון התקנים הישראלי

Yehuda Shemesh

Head of Energy Systems Section

יהודה שמש
ראש מדור מערכות
המנועה למערכת ההידרוליקה
מכון התקנים הישראלי

6.3.18 מהדורה א' 32.7.707



Test Report number: 9813203277/1

Inspection certificate number 9813203277 has been canceled, it took her place.

6. Tests Results:

Standard IEC 617301 Part 1

No.	Subject	Results and details of nonconformance	Verdict
3	Application classes		P
4	Construction requirements		P
5	Polymeric material		P
6	Internal wiring and current – carrying parts		P
7	Connections		P
8	Bonding and grounding		P
9	Creepage and clearance distances		P
10	Field wiring compartments with covers		P
11	Marking		P
12	Requirements for supplied documents		P

**Test Report number: 9813203277/1**

Inspection certificate number 9813203277 has been canceled. it took her place.

Standard IEC 617301 Part 2

No.	Subject and details of nonconformance		Results	Verdict
6	Sampling			P
9	Pass criteria			P
10				P
	Test procedures	+ Tested in practice	MST 01	P
			MST 11	P
			MST 12	P
		Double insulation	MST 13	P
			MST 14	P
			MST 15	P
		Tested in practice >100 MΩ, 8 kV DC	MST 16	P
			MST 17	P
			MST 21	P
			MST 23	P
			MST 26	P
			MST 32	P
11				P
	Component tests		MST 15	P
			MST 33	P
			MST 44	P

Standard IEC 61215

4.1	Hail test	This paragraph is tested in accordance with the method defined in UL Standard 1703 .	P
-----	-----------	--	---




Test Report number: 9813203277/1

Inspection certificate number 9813203277 has been canceled. it took her place.

Appendix 1

Photo Documentation

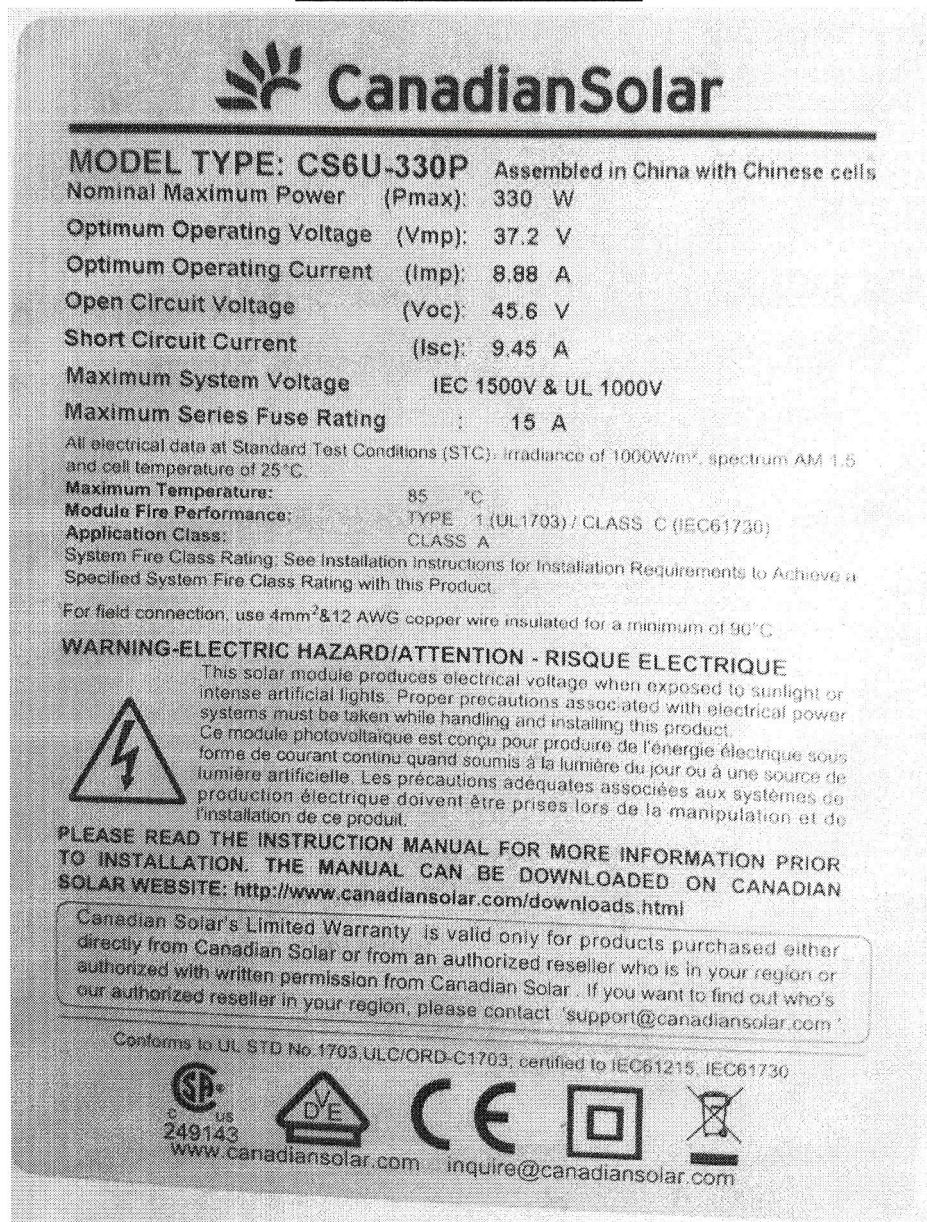


CanadianSolar 11711040632071



Test Report number: 9813203277/1


Inspection certificate number 9813203277 has been canceled. it took her place.

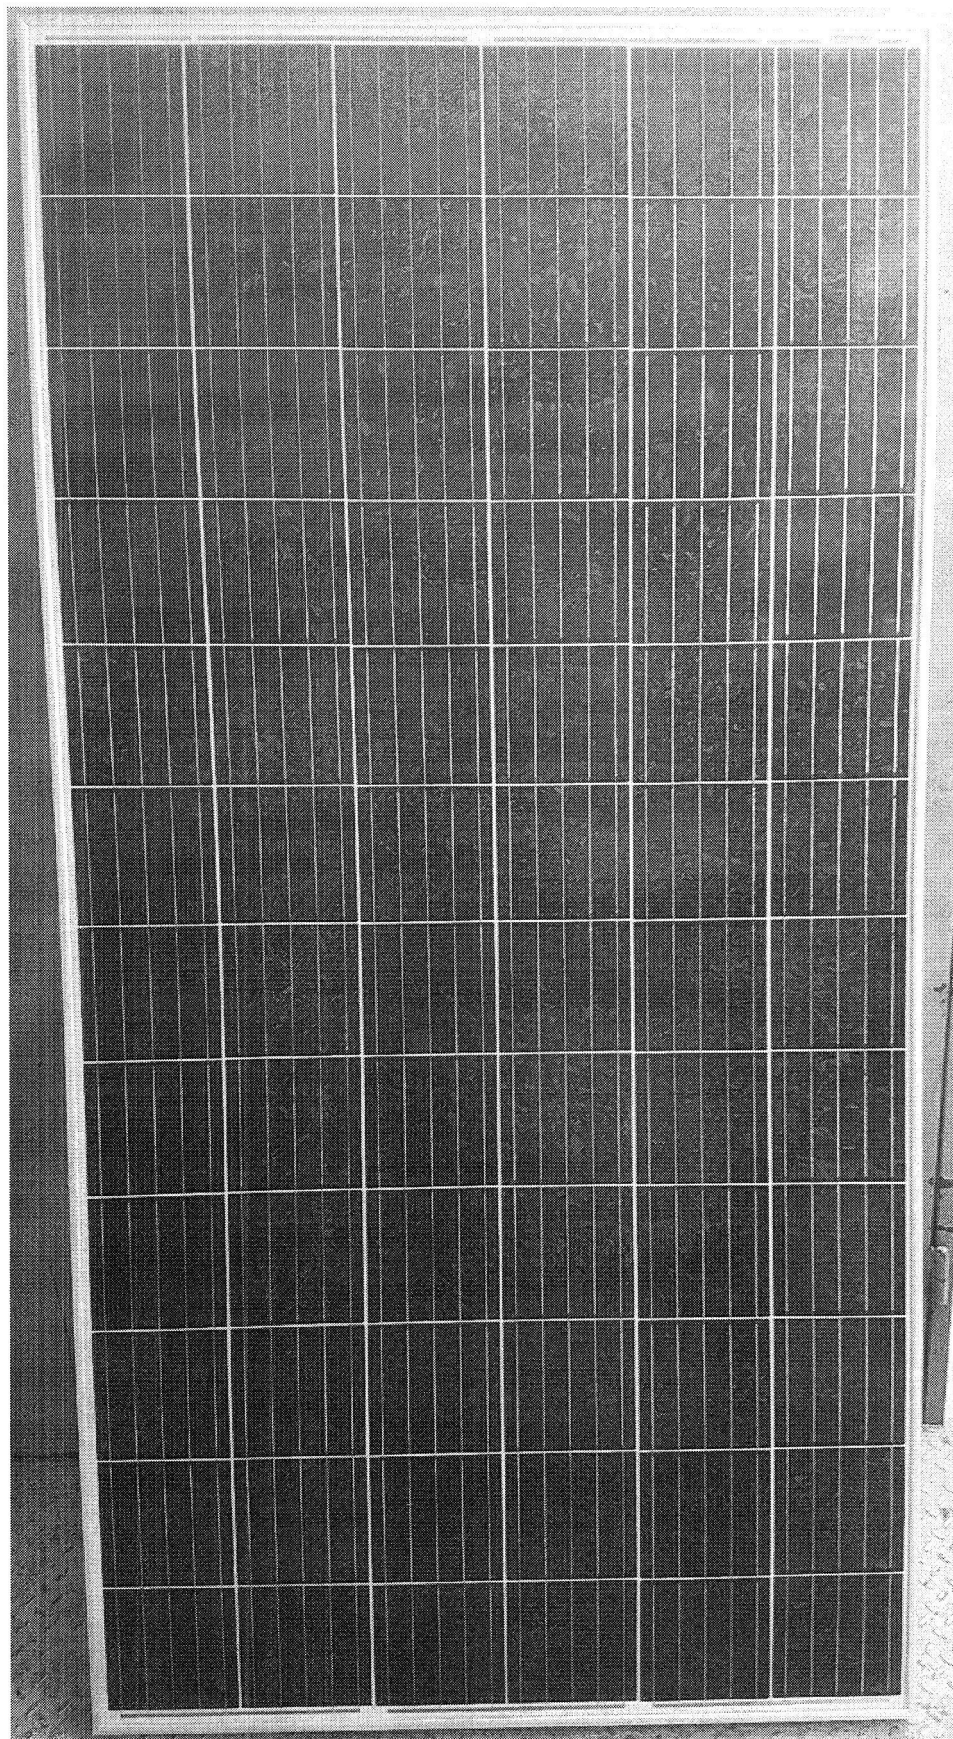



Test Report number: 9813203277/1

Inspection certificate number 9813203277 has been canceled. it took her place.

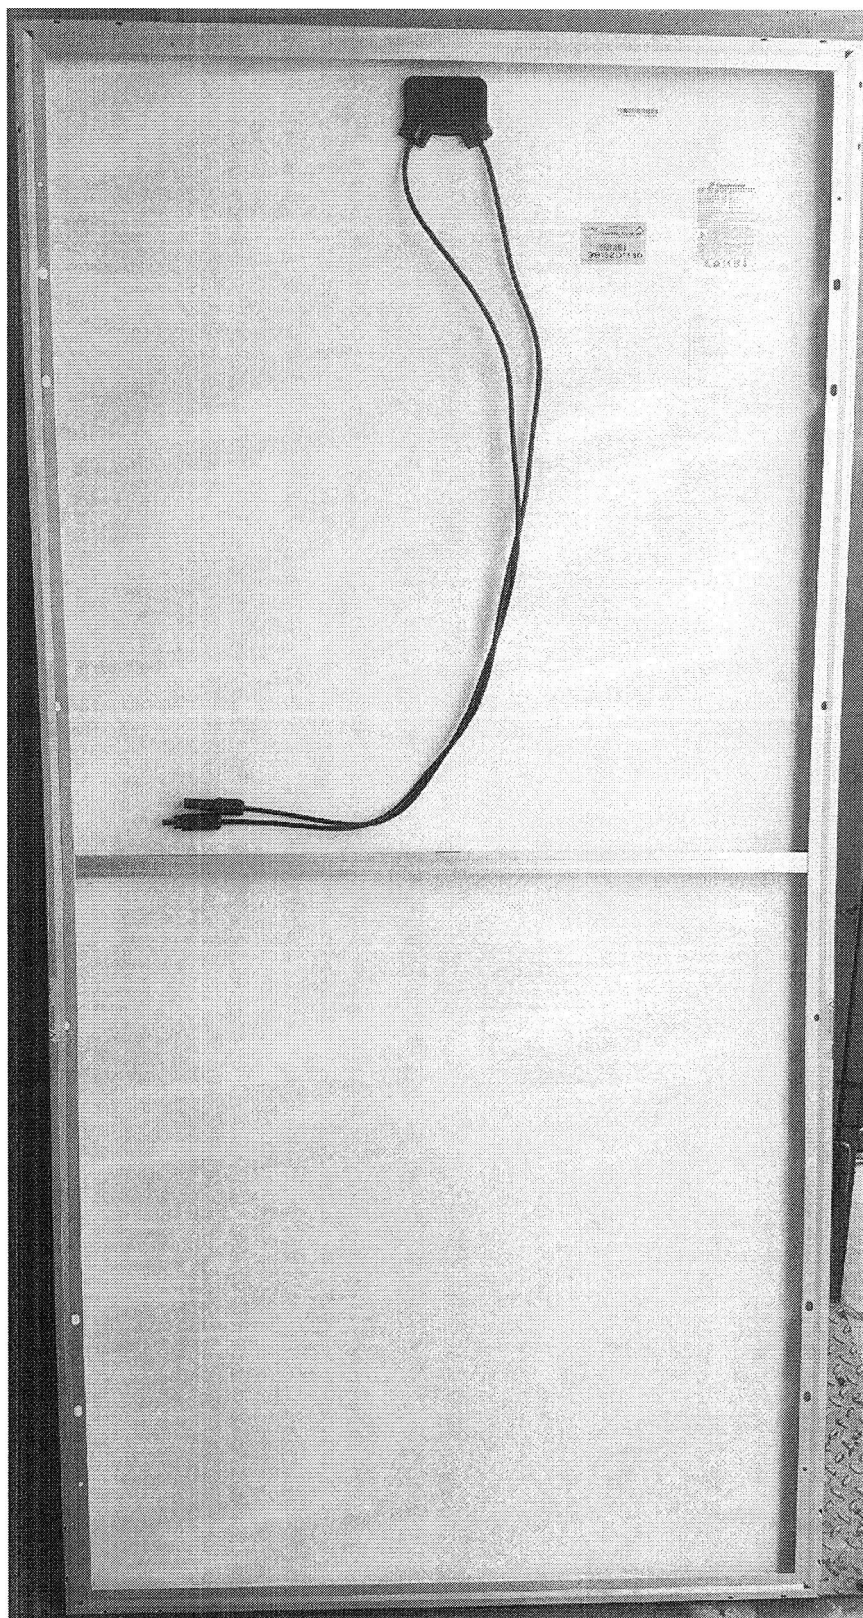



Test Report number: 9813203277/1

Inspection certificate number 9813203277 has been canceled. it took her place.

